

Upavon Infiltration Reduction Plan Summary

This provides an update on the last year's groundwater situation, what mitigation actions, if any, were taken and a summary of our action plan to prevent flooding due to groundwater infiltration of our sewer network.

April 2024 – March 2025

Regional Summary

2024 continued to be a very wet year in the Wessex Water region, with above average rainfall in the majority of months. In particular, groundwater levels rose dramatically in September 2024, where the region recieved over 250% of the monthly average rainfall. This resulted in many catchments experiencing inundation from groundwater much earlier than usual.

Whilst December was relatively dry, above-average rainfall for the remainder of the autumn and winter meant that groundwater levels remained elevated until March, at which point the drier weather enabled the majority of catchments to recover.

[Record-breaking rainfall for some this September - Met Office](#)

Local Summary

While groundwater levels in the Upavon catchment did not reach the highs of the previous year, they did reach critical levels, however no mitigation was required. When levels were at their peak, Andover Road sewage pumping station (SPS) did surcharge, but no incidents attributed to inadequate hydraulic capacity (IHC) were reported.

Action Plan

Annual Activity

Review asset and operational data and update annual reports.

Continue monitoring system performance using telemetry, rainfall records and local groundwater levels to inform the operational response during high-groundwater periods, and to monitor changing infiltration levels in the catchment.

Use machine learning to predict flows in sewers and proactively identify blockages and other issues.

Undertake pro-active cleaning (jetting) of sewers to maximise capacity.

Proactive inspections and maintenance of sewerage assets.

Completed

Installed permanent flow meters at key pumping stations to continuously record pump performance.

Updated the catchment hydraulic model.

Inspected public sewer network to identify points of infiltration.

Installed in-sewer monitors at key locations to better understand flows in the network.

Sealed sewers and manholes to prevent groundwater infiltration.

Completed (cont.)

Undertaken pumping station or flow surveys to analyse flows in sewers.

Reviewed incidents of sewer flooding.

Implemented a scheme to address capacity issues in the sewer network.

Short Term

Undertake pro-active inspection of public sewers and manholes using CCTV to identify points of infiltration.

Install in-sewer monitors at key locations to better understand flows in the network.

Medium Term

Infiltration sealing of sewers and manholes, where deemed cost-effective, targeting work according to study findings.

Upgrade pumping stations where appropriate, to improve the reliability and performance of the site.

Long Term

Identify road gullies and other impermeable areas that are connected into the foul sewers.

Inspect private gullies, drains, and manholes where applicable.

Consider sustainable solutions to rainwater management, for example above-ground attenuation and property-level interventions.


When Necessary

Implement emergency tankering procedure for preventing restricted toilet use and sewer flooding during high groundwater periods, in order to protect public health.

Implement Operational Mitigation Action Plan (OMAP) for discharging excess flows to the environment as a last resort, when tankering would not prevent restricted toilet use or sewer flooding, and public health is at risk.

Current Performance

Following a flood alleviation scheme at North Newton in March 2015 and sealing upstream of Andover Road in May 2014, there was a significant reduction in flooding incidents attributed to inadequate hydraulic capacity. However, following extreme groundwater levels in 2019/2020 & 2022/23 further flooding attributed to inadequate hydraulic capacity (IHC) was reported. Extended pump run times at both Andover Road and North Newton during periods of high river levels indicates there is still groundwater infiltration affecting the catchment.

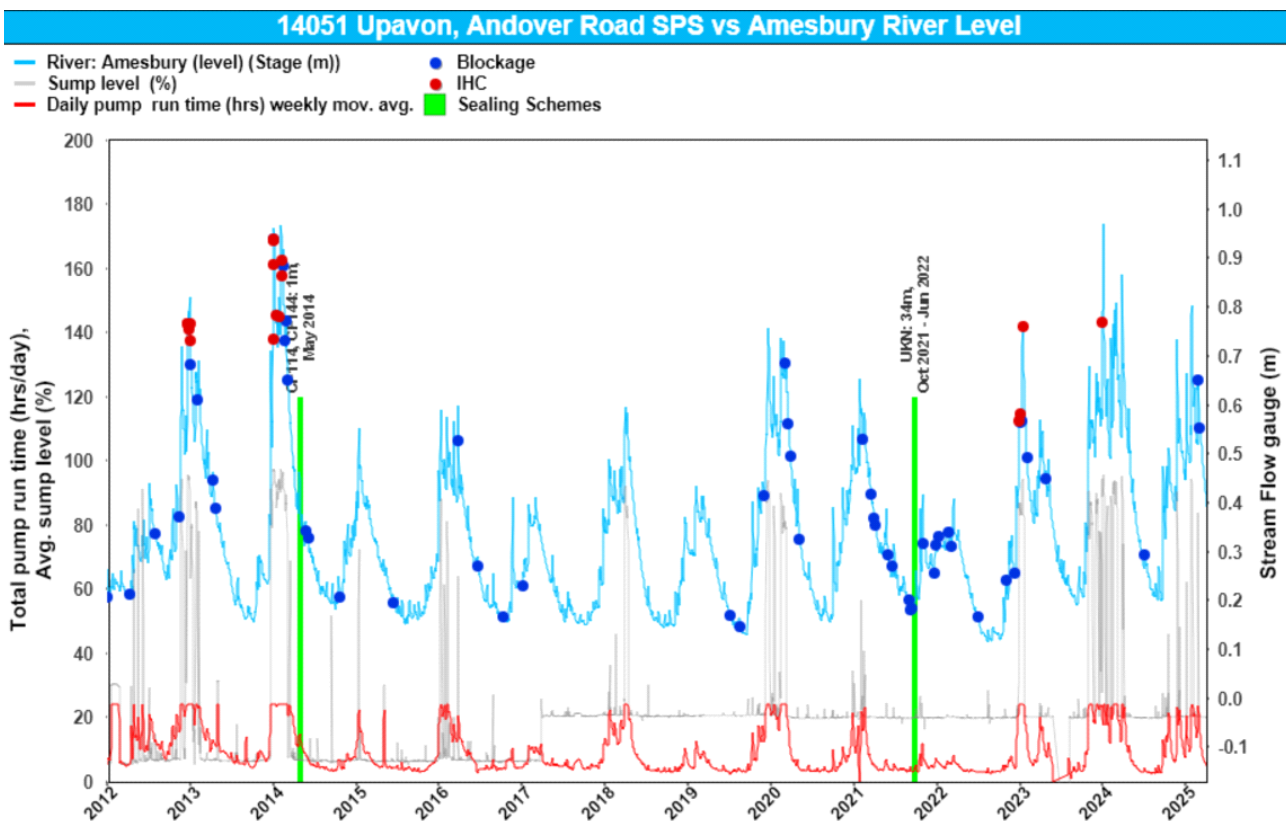

Inspection and sealing since 2011

	2011-20	2020-21	2021-22	2022-23	2023-24	2024-25
Length of sewer inspected (m)	8,886	-	7,566	-	1,493	22
Length of sewer sealed (m)	2	-	25	11	-	123